

State of California

AIR RESOURCES BOARD

Executive Order G-70-6

Relating to the Certification of the OPW System Y Type 2,
Vapor Recovery System for Underground Storage Tanks
at Gasoline Service Stations

Pursuant to the authority vested in the Air Resources Board by Health
and Safety Code Section 41954; and

Pursuant to the authority vested in the undersigned by Health and Safety
Code Sections 39515 and 39516;

IT IS ORDERED AND RESOLVED: that, except as provided below, the Dover
Corporation, OPW Division, System Y, Type 2, vapor recovery system, with
or without a pressure-vacuum valve, is hereby certified for use on
underground gasoline storage tanks at service stations. The system
certified hereby is shown in Exhibit I, attached.

IT IS FURTHER ORDERED AND RESOLVED: that use of the pressure-vacuum
valve be subject to approval of the local fire chief, and that the tanks
and piping be in compliance with the appropriate General Industry Safety
Orders and in particular the provisions in Articles 144, 145, and 146
thereof.

Executed at Sacramento, California, this 26th day of April 1977.


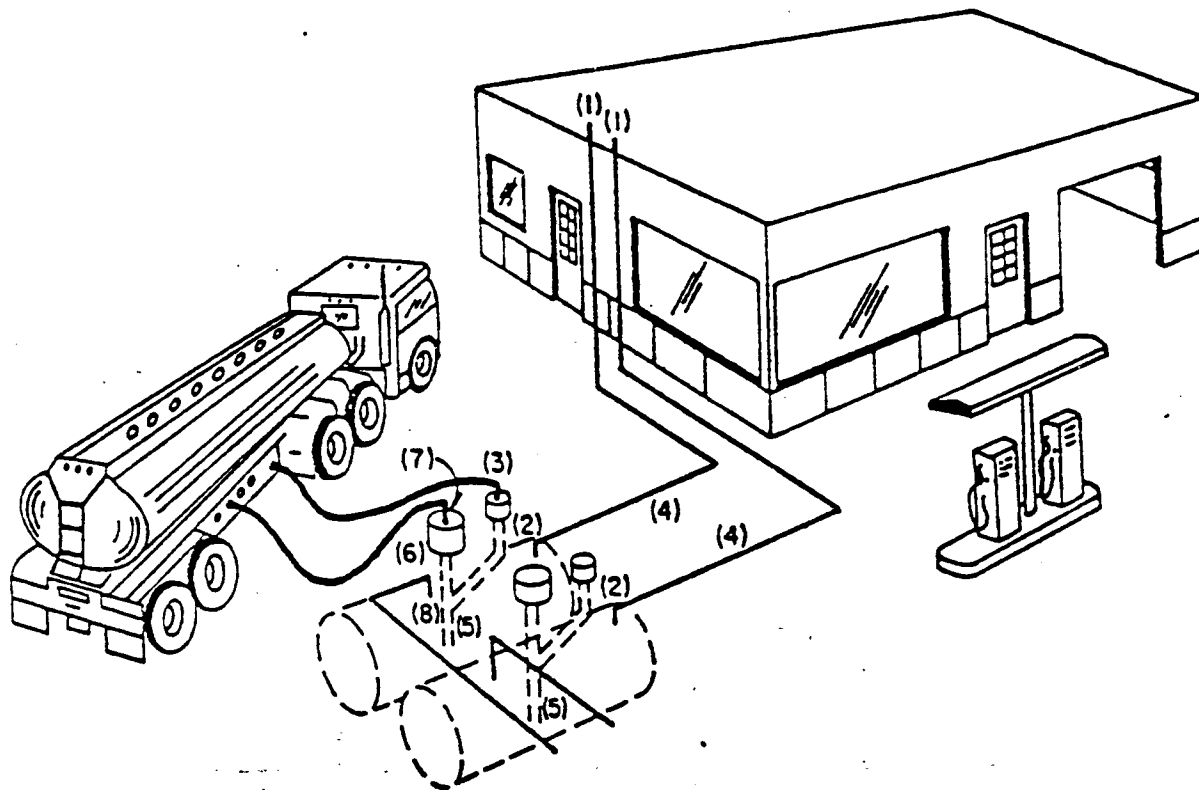

William H. Lewis, Jr.
Executive Officer

EXHIBIT 1

OPW SYSTEM Y TYPE 2 VAPOR RECOVERY SYSTEM



PARTS LIST (Note 1)

- | | |
|---|--|
| <p>(1) P/V Valve (optional). (Note 1 & 2).</p> <p>(2) OPW 1611 - AV 3" Dry break with an OPW 1711T or OPW 1711TK Locking cap.</p> <p>(3) OPW 1711 - V3" Elbow.</p> <p>(4) 2" Vent pipe.</p> | <p>(5) OPW 61-TD Aluminum drop tube (extend to within 6" bottom of tank).</p> <p>(6) OPW 61AS Adapter or OPW 633T Adapter.</p> <p>(7) OPW 60 Elbow or OPW 60T Elbow.</p> <p>(8) OPW 318-VM Y-Type Fitting.</p> |
|---|--|

Notes:

1. Interchangeable fittings, dust caps, and P/V valves are given in Executive Order G-70-2-B.
2. Vent pipes may be manifolded.